



WEST COAST CHILLERS

INSPECTION & OPERATIONAL REPORT

CHILLER INFORMATION

MODEL #: YLAA0120SE

TYPE: AIR COOLED

BRAND: YORK

MAN. DATE: 2017

S/N: 11551E76243811

VOLTS/HZ/PH: 460/60/3

CHILLER DIMENSIONS: SKID OVERALL

W 7.7' x L 13.6' x H 8.6'

CHILLER WEIGHT: 6,800 LBS + SKID

CHILLER OPERATING DATA

TEST RUN DATE: 8/7/2026

VOLTS L1/L2: 482 L1/L3: 483 L2/L3: 483

AMPS L1: L2: L3:

SYS 1. SUBCOOLING: 19.7°F SUPERHEAT: 9.3°F EXV POSITION: 46%

SYS 2. SUBCOOLING: 18.9°F SUPERHEAT: 8.0°F EXV POSITION: 40%

ID		COMPRESSOR MAKE/ MODEL				RUNNING AMPS	
C1	C2	CIRCUIT 1		CIRCUIT 2		C1	C2
1A	2A	MODEL # ZP385KCE-TED-951		MODEL # ZP385KCE-TED-951		47	47
		S/N 23DA16192		S/N 23CX0025D		48	48
OIL:	OIL:	HOURS: 1	CCH: YES	HOURS: 1	CCH: YES	46	47
1B	2B	MODEL # ZP385KCE-TED-951		MODEL # ZP385KCE-TED-951		47	47
		S/N 23FA1657D		S/N 23FA1653D		48	48
OIL:	OIL:	HOURS: 1	CCH: YES	HOURS: 1	CCH: YES	46	46
OIL:	OIL:	HOURS:	CCH:	HOURS:	CCH:		

REFRIGERANT TYPE: ☒ R410A ☐ R407C ☐ R717 ☐ R134A ☐ R22 ☐ R404A

REFRIGERANT LEVEL: CIRCUIT 1: 54 LBS, CIRCUIT 2: 62 LBS

AMBIENT TEMP: 81°F

SETPOINT: 40°F

LEAVING CHILLER: 41.5°F

ENTER/ RETURN: 47°F

MINIMUM SETPOINT: 10°F

PUMP 1 HP/AMPS:

PUMP 2 HP/AMPS:

FLOW SWITCH: DIFF. SWITCH

HEAT EXCHANGER: BRAZED PLATE

METERING DEVICE: EXV



WEST COAST CHILLERS

INSPECTION & OPERATIONAL REPORT


CONDENSER FANS

CONDENSER FIN CONDITION: MICROCHANNEL

☐ EXCEPTIONAL ☐ VERY GOOD ☒ GOOD ☐ OK

NUMBER OF FANS: 6

CONDENSOR FAN						
RUNNING AMPS						
CIRCUIT 1				CIRCUIT 2		
	L1	L2	L3	L1	L2	L3
A	3.1			3.0		
B	2.9			3.01		
C	3.1			3.1		
D						

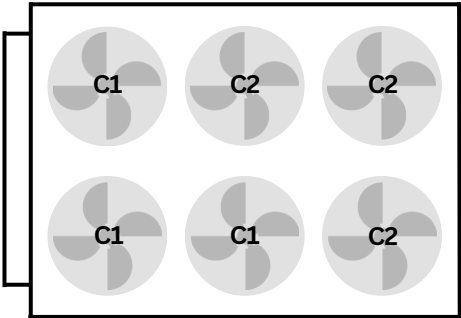

INSPECTION NOTES:

ALL NEW COMPRESSORS INSTALLED. REPLACED BITZERS WITH COPELAND
ZP385KCE
REMOVED PUMP SKID, NOT NEEDED