



WEST COAST CHILLERS

INSPECTION & OPERATIONAL REPORT

CHILLER INFORMATION

MODEL #: CGAM 080F 2L02 AX02 A1A1 B1AX XA1D 1AXX XXXX XBXA 3A10 1XXC XX

TYPE: AIR COOLED SCROLL CHILLER

BRAND: TRANE

VOLTS/HZ/PH: 460/60/3

MAN. DATE: 2015

CHILLER DIMENSIONS: W 7.5' x L 12.3' x H 8'

S/N: U15D48052

CHILLER WEIGHT: 5,800 LBS

CHILLER OPERATING DATA

TEST RUN DATE: 8/22/2026

VOLTS L1/L2: 480 L1/L3: 481 L2/L3: 482

AMPS L1: L2: L3:

SYS 1. SUBCOOLING: 18°F **SUPERHEAT:** 11°F **EXV POSITION:** 56%

SYS 2. SUBCOOLING: 16°F **SUPERHEAT:** 10°F **EXV POSITION:** 49%

ID		COMPRESSOR MAKE/ MODEL				RUNNING AMPS	
C1	C2	CIRCUIT 1		CIRCUIT 2		C1	C2
1A	2A	MODEL # CSHN250K0BKM		MODEL # CSHN250K0BKM		29.1	31.6
		S/N 15224XEF6A		S/N 15124MDL6A		28.1	30.8
OIL: F	OIL: F	HOURS: 22,668	CCH: YES	HOURS: 17,891	CCH: YES	29.1	31.8
1B	2B	MODEL # CSHN250K0BKM		MODEL # CSHN250K0BKM		29.2	31.7
		S/N 15123LFK6A		S/N 15124MF96A		28.4	31.1
OIL: F	OIL: F	HOURS: 22,667	CCH: YES	HOURS: 17,846	CCH: YES	29.1	32.0
OIL:	OIL:	HOURS:	CCH:	HOURS:	CCH:		

REFRIGERANT TYPE: ☒ R410A ☐ R407C ☐ R717 ☐ R134A ☐ R22 ☐ R404A

REFRIGERANT LEVEL: GOOD

AMBIENT TEMP: 92°F

PUMP 1 HP/AMPS:

SETPOINT: 44°F

PUMP 2 HP/AMPS:

LEAVING CHILLER: 47°F

FLOW SWITCH: ELECTRONIC

ENTER/ RETURN: 55°F

HEAT EXCHANGER: BRAZED PLATE

MINIMUM SETPOINT: 5°F

METERING DEVICE: EXV



WEST COAST CHILLERS

INSPECTION & OPERATIONAL REPORT


CONDENSER FANS

CONDENSER FIN CONDITION:

☒ VERY GOOD ☐ GOOD ☐ OK

NUMBER OF FANS: 6

CONDENSOR FAN						
RUNNING AMPS						
CIRCUIT 1				CIRCUIT 2		
	L1	L2	L3	L1	L2	L3
A	3.8	4.1	4.0	5.1	5.0	4.9
B	3.0	2.9	3.0	2.98	2.98	2.95
C	3.01	2.9	3.0	2.9	3.0	2.9
D						

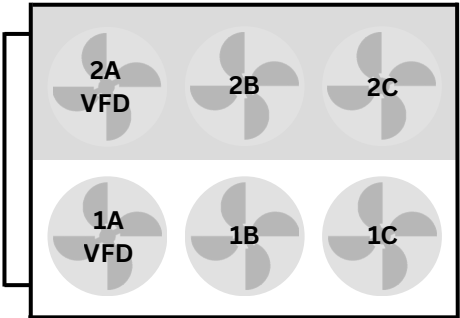

INSPECTION NOTES: